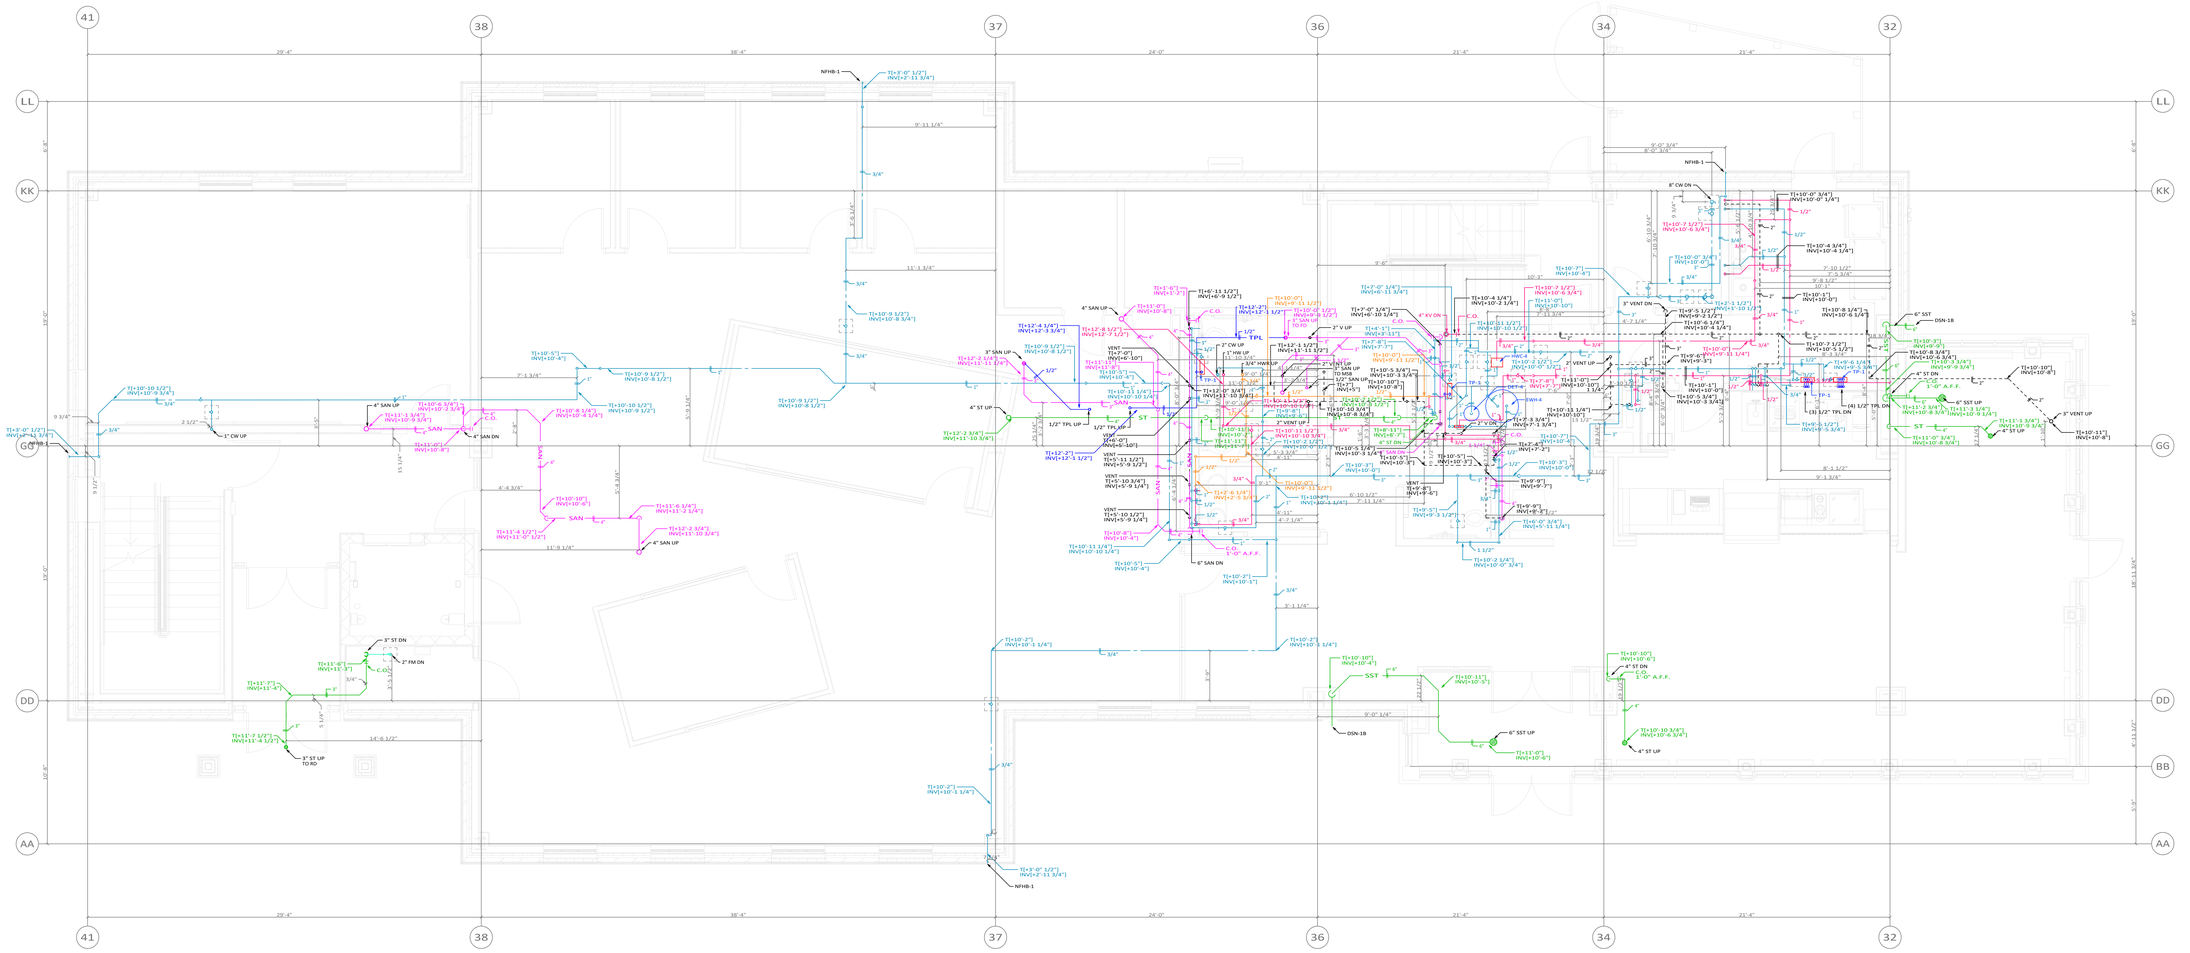

FOR SUBMISSION-ENGINEER REVIEW

All submission drawings are to be approved by the Architect and Engineer prior to any fabrication and installation of system. Field and contract drawing verification required prior to automated fabrication.

KEY PLAN

NO.	REVISIONS	DATE

AUTHORIZED SIGNATURE

AUTHORIZED PERSONNEL (PRINT)

TRADE	COMPANY
MECHANICAL	ROKO MECHANICAL
SHEET METAL	KOOK SHEET METAL
PLUMBING	BMC PLUMBING
ELECTRICAL	ROKO ELECTRIC
FIRE PROTECTION	ROKO MECHANICAL
SPRINKLER	
GEN. CONTRACTOR	HOLDER CONSTRUCTION
ARCHITECT	GWWO INC.
ENGINEER	MUELLER ENG.

CONTRACTORS

THIS DRAWING IS PRODUCED BY:

SHOPDRAWINGS.COM
10315 CANNON FORGE LANE
HAGERSTOWN MD 21742
301-926-6000
WWW.SHOPDRAWINGS.COM

2-P2.1

PROJECT:

ST. MARY'S COLLEGE OF MARYLAND

MAIN BUILDING
47855 COLLEGE DRIVE
ST MARY'S CITY MD 20686

WEST BUILDING

PLUMBING
1ST FLOOR

Scale: 1/4" = 1'-0"

November 13, 2020